ISSUE	DATE	AMENDMENTS
1	26/03/25	ORIGINAL

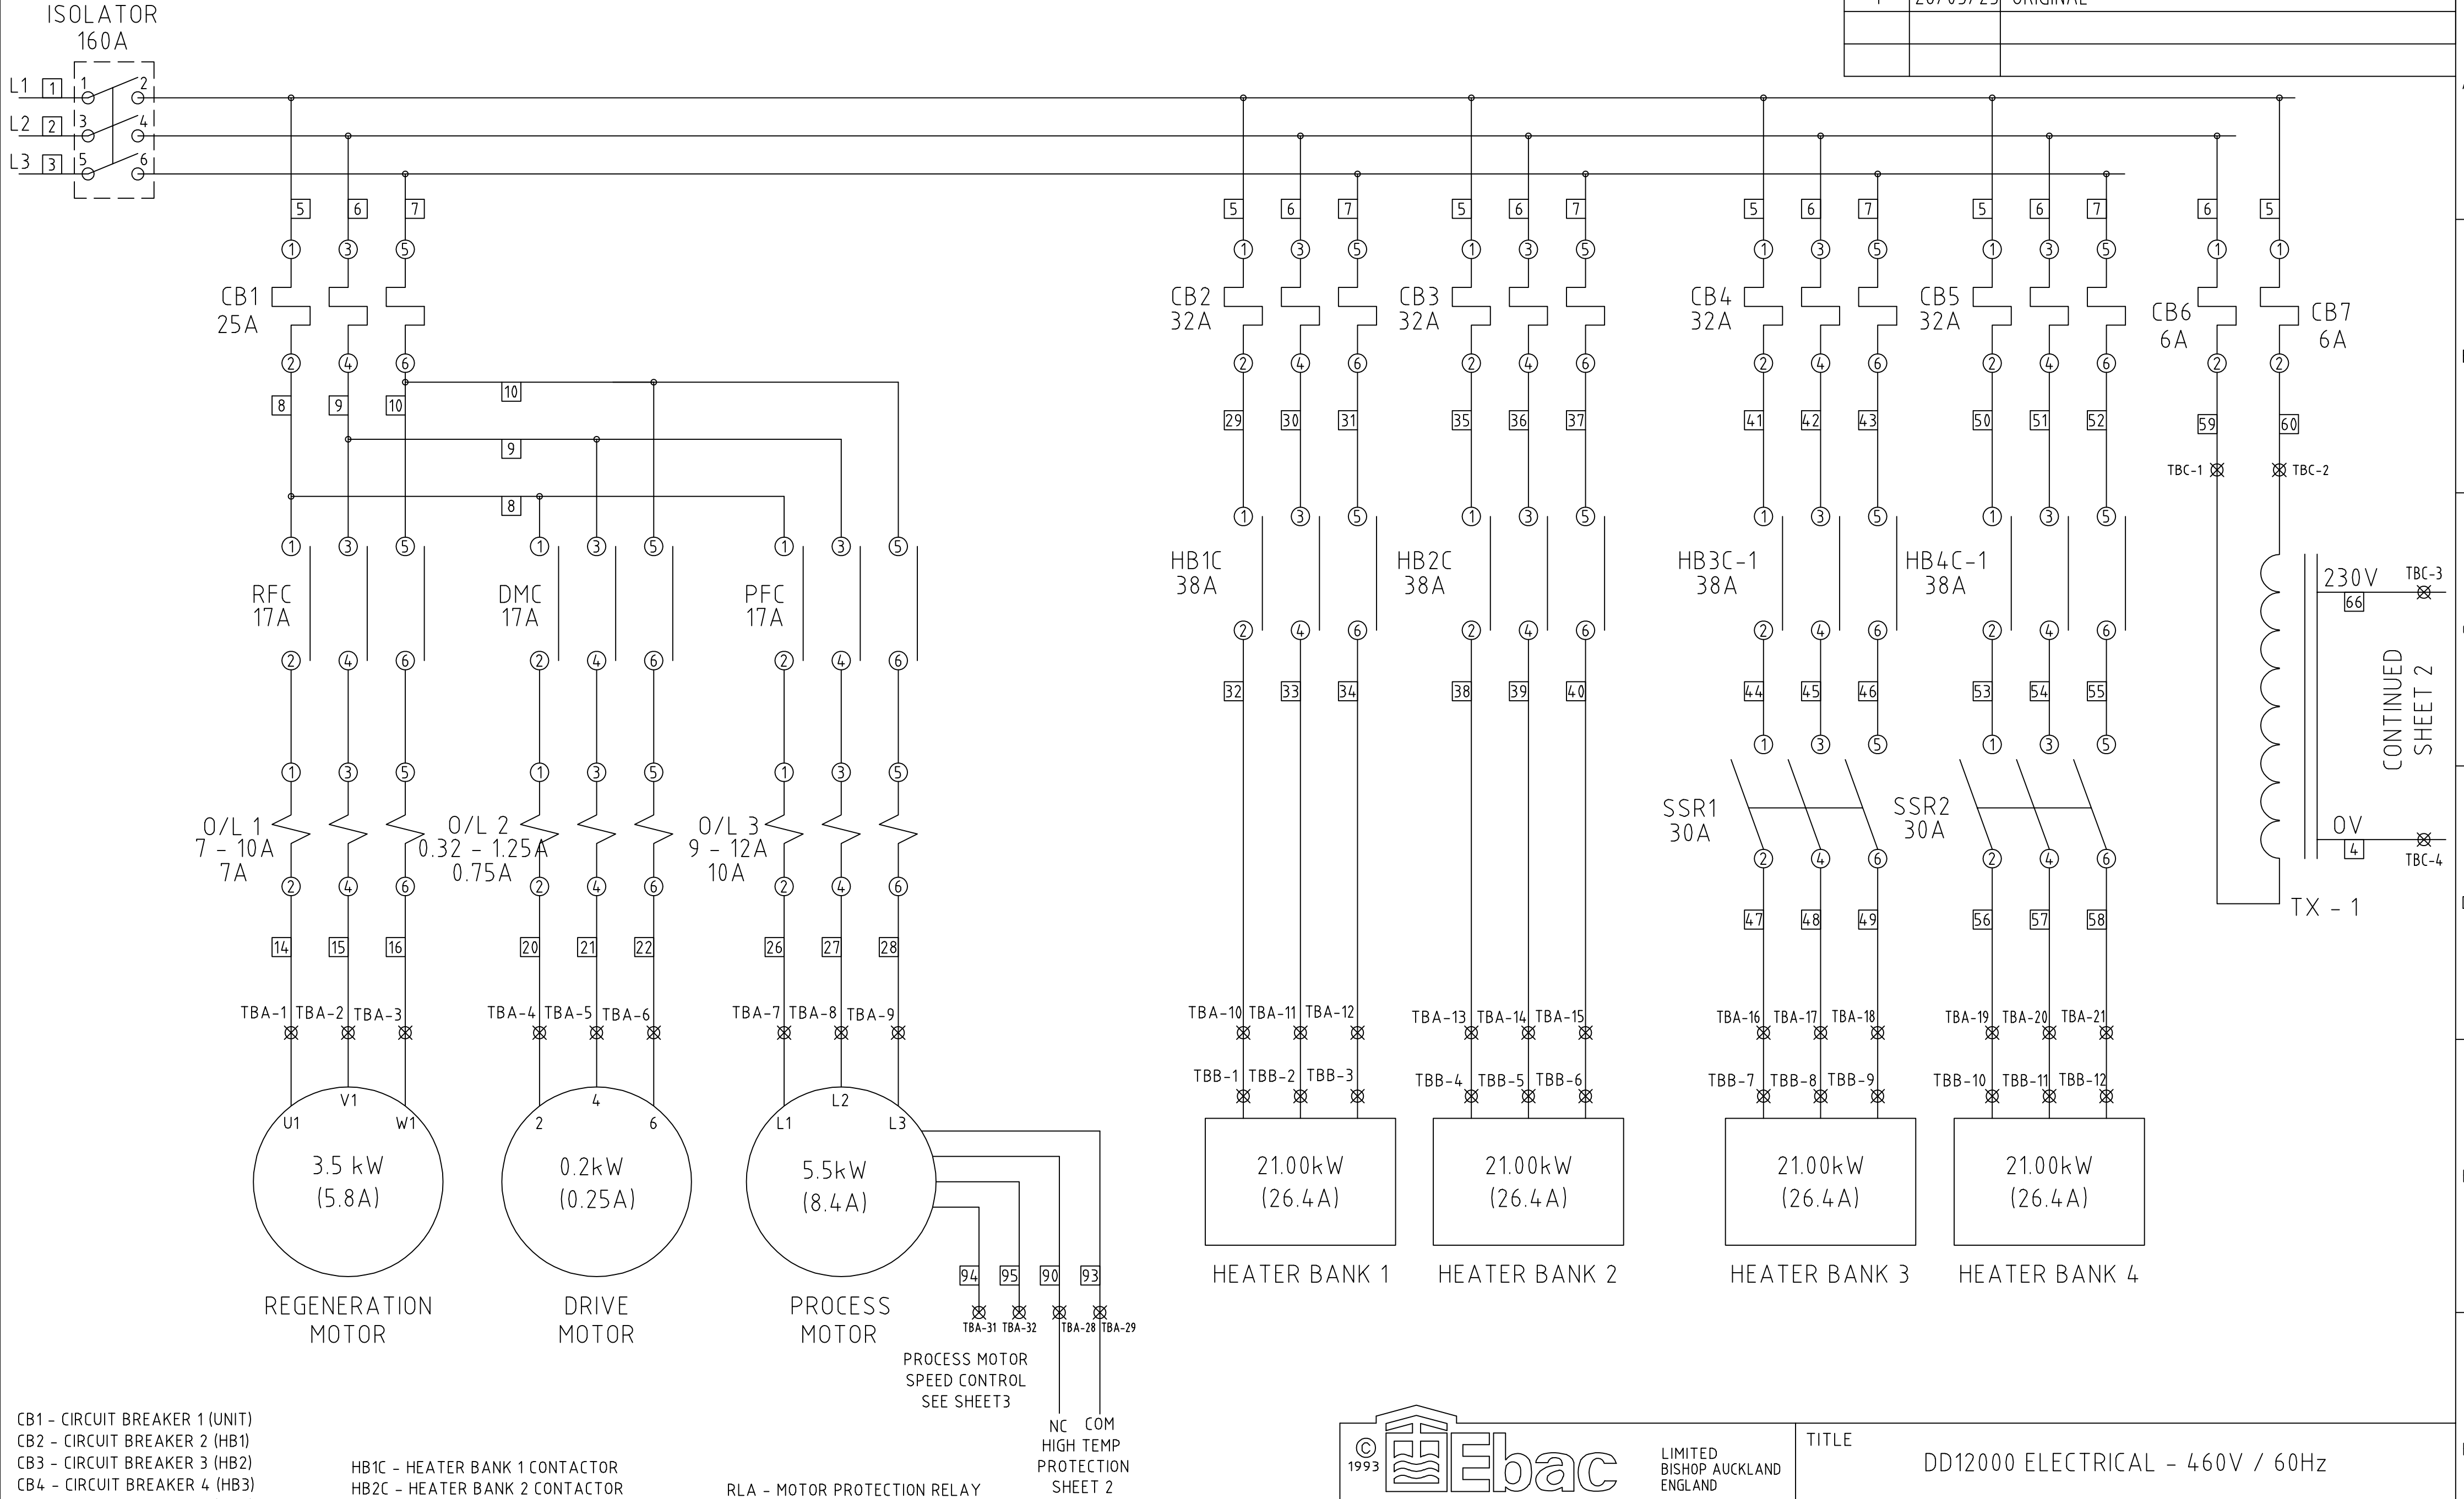

CB1 - CIRCUIT BREAKER 1 (UNIT)
CB2 - CIRCUIT BREAKER 2 (HB1)
CB3 - CIRCUIT BREAKER 3 (HB2)
CB4 - CIRCUIT BREAKER 4 (HB3)
CB5 - CIRCUIT BREAKER 5 (HB4)
CB6 - CIRCUIT BREAKER 6 (TX INPUT)
CB7 - CIRCUIT BREAKER 7 (TX INPUT)
CB8 - CIRCUIT BREAKER 8 (CONTROLS)
RFC - REGENERATION FAN CONTACTOR
DMC - DRIVE MOTOR CONTACTOR
PFC - PROCESS FAN MOTOR CONTACTOR

HB1C - HEATER BANK 1 CONTACTOR
HB2C - HEATER BANK 2 CONTACTOR
HB3C - HEATER BANK 3 CONTACTOR
HB4C - HEATER BANK 4 CONTACTOR
SSR1 - HEATER BANK 3 SOLID STATE RELAY
SSR2 - HEATER BANK 4 SOLID STATE RELAY
O/L1 - REGENERATION FAN OVERLOAD
O/L2 - DRIVE MOTOR OVERLOAD
O/L3 - PROCESS FAN OVERLOAD

RLA - MOTOR PROTECTION RELAY
RLB - HEATER PROTECTION RELAY
RLC - START RELAY
RLD - DRYING REQUIRED RELAY
RLE - ROTATION SENSOR RELAY
TD1 - PROCESS FAN START DELAY
TD2 - PROCESS FAN STOP DELAY
TEI - TIME ELAPSED INDICATOR

TBA - CONTROL PANEL
TBB - HEATER BOX
TBC - TRANSFORMER
TBD - CONTROLLER
TBE - HUMIDISTAT
TX1 - TRANSFORMER

Ebac LIMITED
BISHOP AUCKLAND
ENGLAND

TITLE: DD12000 ELECTRICAL - 460V / 60Hz

3RD ANGLE PROJECTION
DO NOT SCALE
IF IN DOUBT ASK

DIMENSIONS IN m.m.
TOLERANCES UNLESS
OTHERWISE STATED
0. ± 1
0.0 ± 0.25
0.00 ± 0.05
ANGULAR ± 0.5 DEGREE

MATERIAL: N/A
FINISH: N/A
DRAWN: W DAGLISH
CAD SCALE: N/A
DRG.NO. 5020444
SHEET 1 OF 3

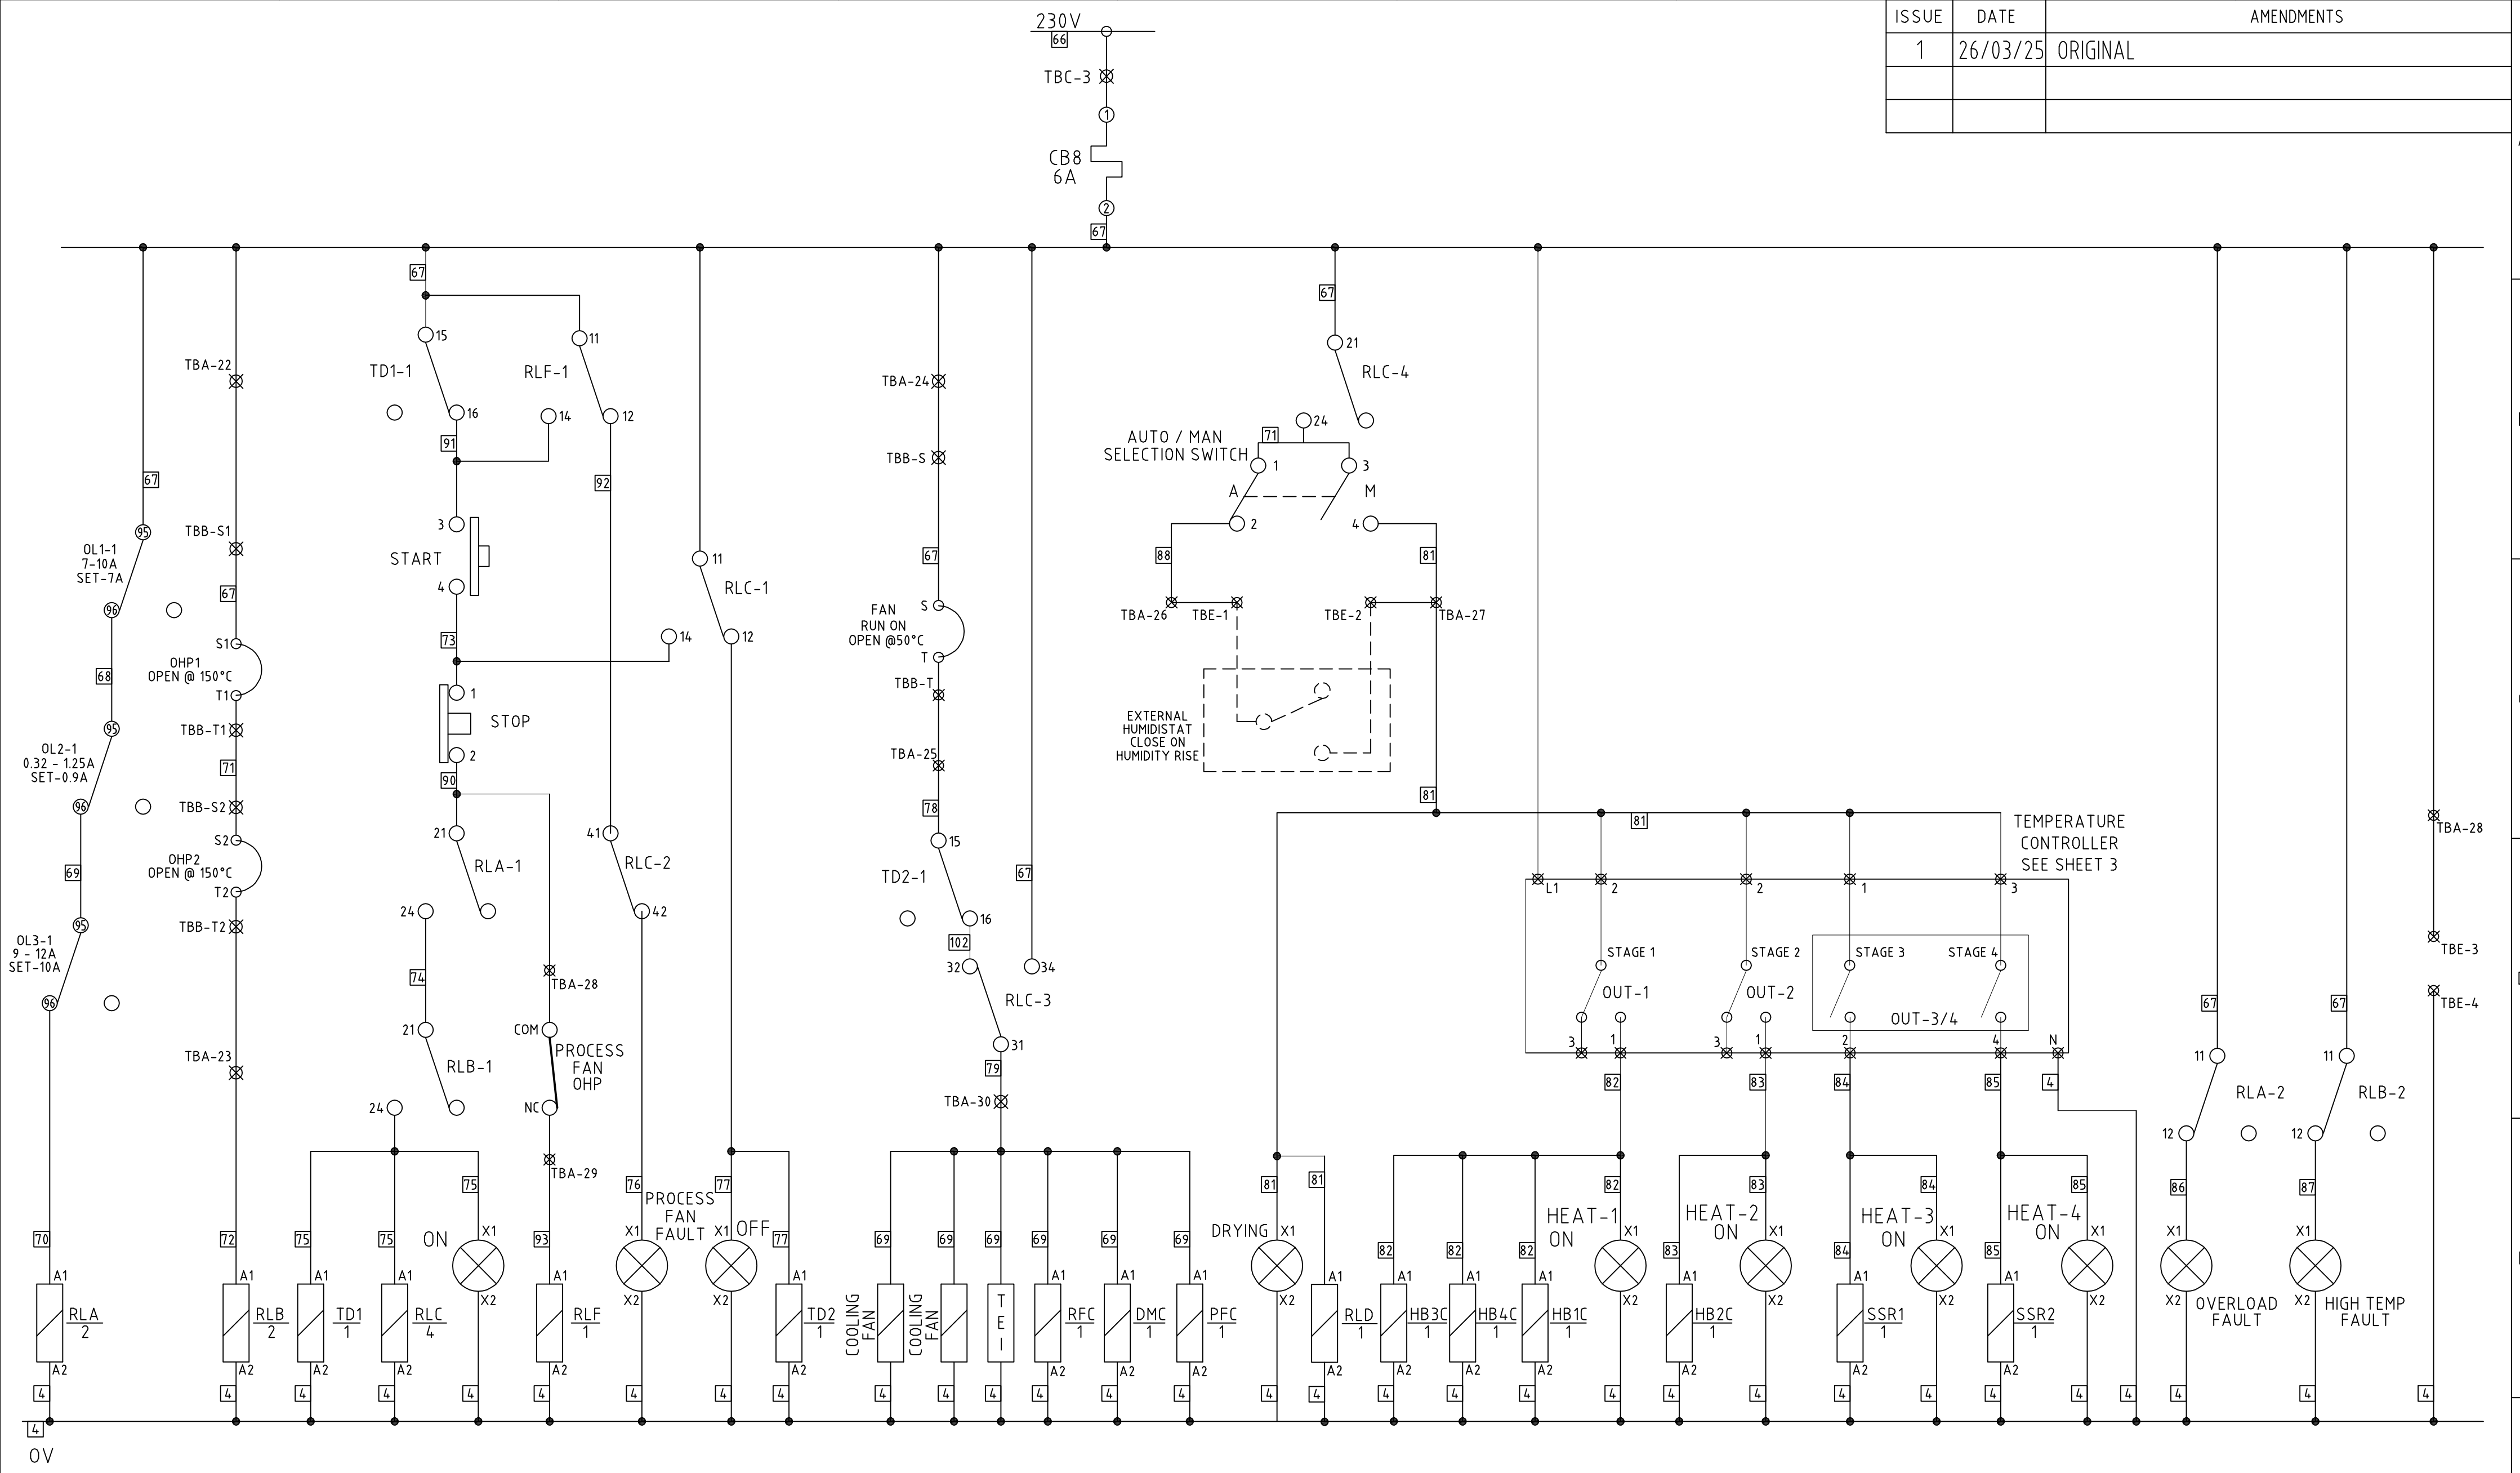

ISSUE	DATE	AMENDMENTS
1	26/03/25	ORIGINAL

CB1 - CIRCUIT BREAKER 1 (UNIT)
CB2 - CIRCUIT BREAKER 2 (HB1)
CB3 - CIRCUIT BREAKER 3 (HB2)
CB4 - CIRCUIT BREAKER 4 (HB3)
CB5 - CIRCUIT BREAKER 5 (HB4)
CB6 - CIRCUIT BREAKER 6 (TX INPUT)
CB7 - CIRCUIT BREAKER 7 (TX INPUT)
CB8 - CIRCUIT BREAKER 8 (CONTROLS)
RFC - REGENERATION FAN CONTACTOR
DMC - DRIVE MOTOR CONTACTOR
PFC - PROCESS FAN MOTOR CONTACTOR

HB1C - HEATER BANK 1 CONTACTOR
HB2C - HEATER BANK 2 CONTACTOR
HB3C - HEATER BANK 3 CONTACTOR
HB4C - HEATER BANK 4 CONTACTOR
SSR1 - HEATER BANK 3 SOLID STATE RELAY
SSR2 - HEATER BANK 4 SOLID STATE RELAY
O/L1 - REGENERATION FAN OVERLOAD
O/L2 - DRIVE MOTOR OVERLOAD
O/L3 - PROCESS FAN OVERLOAD

RLA - MOTOR PROTECTION RELAY
RLB - HEATER PROTECTION RELAY
RLC - START RELAY
RLD - DRYING REQUIRED RELAY
RLE - ROTATION SENSOR RELAY
TD1 - PROCESS FAN START DELAY
TD2 - PROCESS FAN STOP DELAY
TEI - TIME ELAPSED INDICATOR

TBA - CONTROL PANEL
TBB - HEATER BOX
TBC - TRANSFORMER
TBD - CONTROLLER
TBE - HUMIDISTAT
TX1 - TRANSFORMER

 Ebac LIMITED BISHOP AUCKLAND ENGLAND

TITLE DD12000 ELECTRICAL - 460V / 60Hz

3RD ANGLE PROJECTION

DO NOT SCALE
IF IN DOUBT ASK

DIMENSIONS IN m.m.
TOLERANCES UNLESS OTHERWISE STATED
0. ± 1
0.0 ± 0.25
0.00 ± 0.05
ANGULAR ± 0.5 DEGREE

MATERIAL N/A

FINISH N/A

DRAWN: W DAGLISH

CAD SCALE: N/A

DRG.NO. 5020444

SHEET 2 OF 3

ISSUE	DATE	AMENDMENTS
1	26/03/25	ORIGINAL

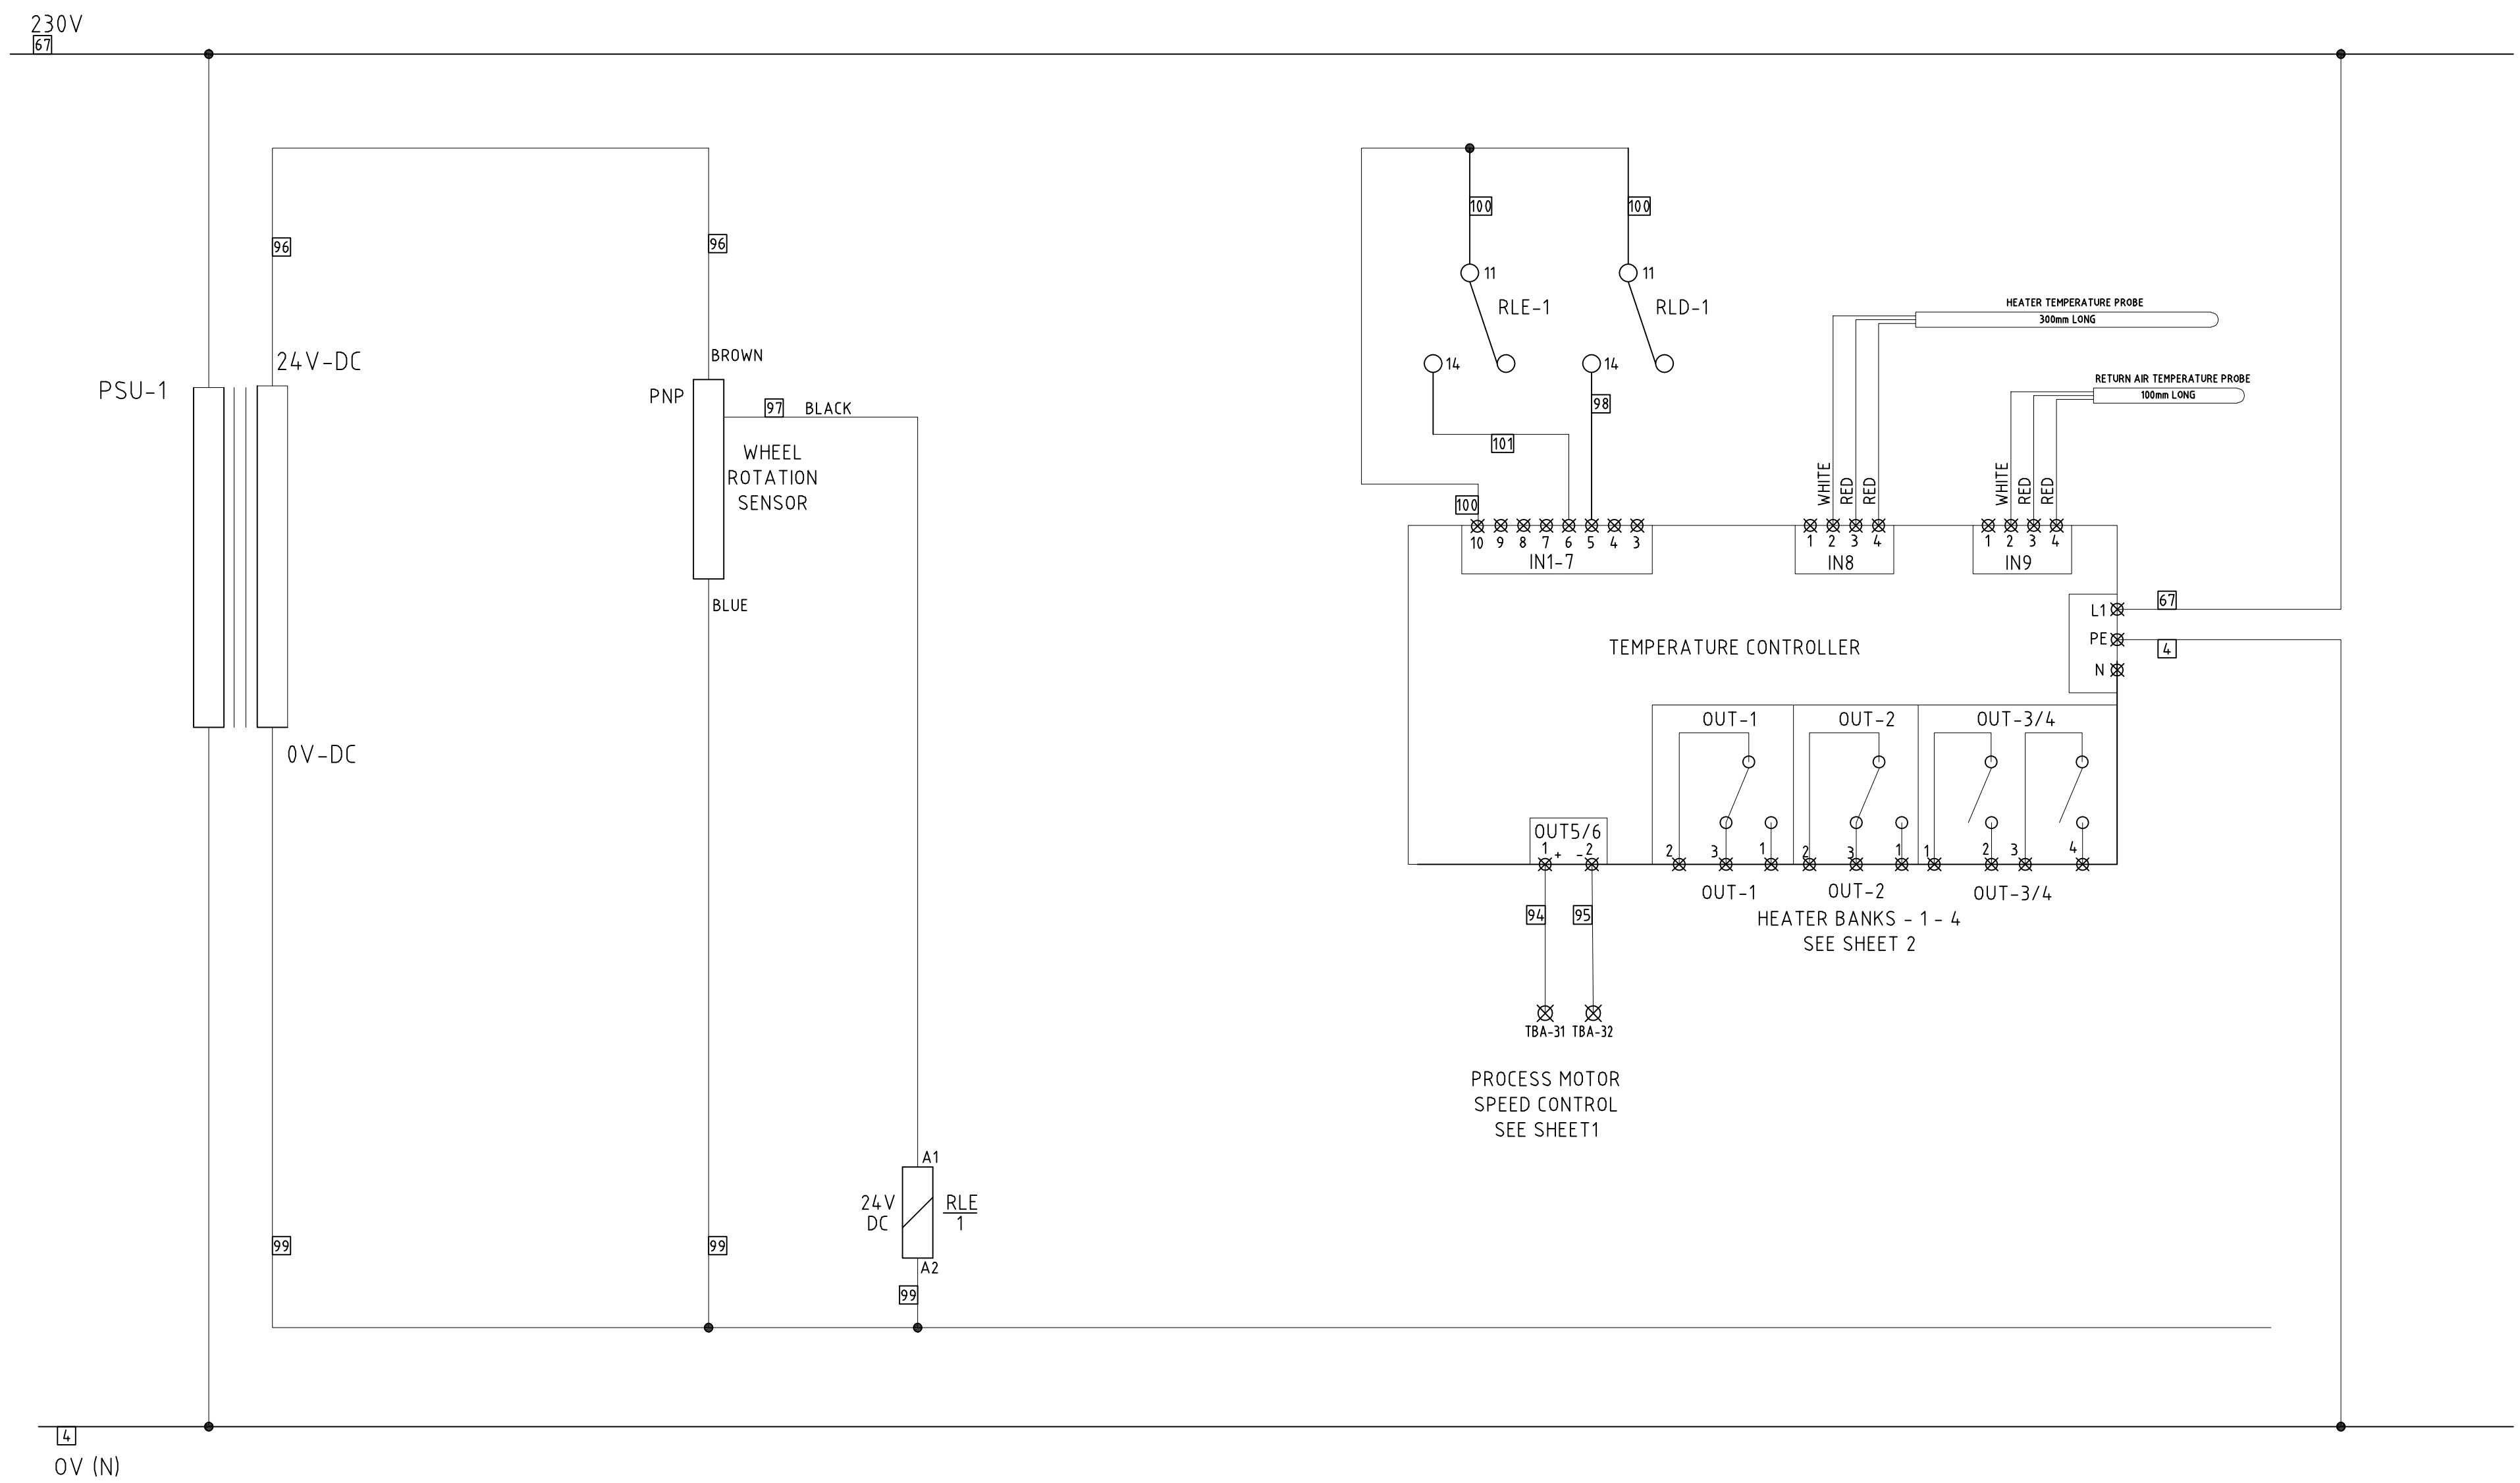

CB1 - CIRCUIT BREAKER 1 (UNIT)
CB2 - CIRCUIT BREAKER 2 (HB1)
CB3 - CIRCUIT BREAKER 3 (HB2)
CB4 - CIRCUIT BREAKER 4 (HB3)
CB5 - CIRCUIT BREAKER 5 (HB4)
CB6 - CIRCUIT BREAKER 6 (TX INPUT)
CB7 - CIRCUIT BREAKER 7 (TX INPUT)
CB8 - CIRCUIT BREAKER 8 (CONTROLS)
RFC - REGENERATION FAN CONTACTOR
DMC - DRIVE MOTOR CONTACTOR
PFC - PROCESS FAN MOTOR CONTACTOR

HB1C - HEATER BANK 1 CONTACTOR
HB2C - HEATER BANK 2 CONTACTOR
HB3C - HEATER BANK 3 CONTACTOR
HB4C - HEATER BANK 4 CONTACTOR
SSR1 - HEATER BANK 3 SOLID STATE RELAY
SSR2 - HEATER BANK 4 SOLID STATE RELAY
O/L1 - REGENERATION FAN OVERLOAD
O/L2 - DRIVE MOTOR OVERLOAD
O/L3 - PROCESS FAN OVERLOAD

RLA - MOTOR PROTECTION RELAY
RLB - HEATER PROTECTION RELAY
RLC - START RELAY
RLD - DRYING REQUIRED RELAY
RLE - ROTATION SENSOR RELAY
TD1 - PROCESS FAN START DELAY
TD2 - PROCESS FAN STOP DELAY
TEI - TIME ELAPSED INDICATOR

TBA - CONTROL PANEL
TBB - HEATER BOX
TBC - TRANSFORMER
TBD - CONTROLLER
TBE - HUMIDISTAT
TX1 - TRANSFORMER

Ebac LIMITED
BISHOP AUCKLAND
ENGLAND

3RD ANGLE PROJECTION
DO NOT SCALE
IF IN DOUBT ASK

DIMENSIONS IN m.m.
TOLERANCES UNLESS OTHERWISE STATED
0. ± 1
0.0 ± 0.25
0.00 ± 0.05
ANGULAR ± 0.5 DEGREE

TITLE
DD12000 ELECTRICAL - 460V / 60Hz

MATERIAL N/A
FINISH N/A
DRAWN: W DAGLISH
CAD SCALE: N/A
DRG.NO. 5020444
SHEET 3 OF 3